

INSTALLATION INSTRUCTIONS



ELECTRICAL SHOCK HAZARD

READ, UNDERSTAND, and FOLLOW these instructions before installing the equipment.

WARNING

Disconnect the Electrical supply power at the service panel (fuse or circuit breaker box). Failure to do so could result in serious injury or death. Only qualified electricians should install this fixture and the installation **MUST** conform to the Canadian Electrical Code Part I and all local codes and ordinances. Ensure that only proper tools, materials, and equipment are used to complete the installation.

SAFETY


- Proper grounding is required to ensure personal safety.
- Fixture should be mounted in locations where unauthorized personnel will not readily subject it to tampering.
- Do not use this equipment for anything other than its intended purpose.
- Servicing this equipment should be performed by qualified service personnel.
- Save these instructions.

INSTALLATION


Fix the stainless steel hook brackets to the ceiling using the screws provided.

- LFX4: min 768mm (30.25"), max 908mm (35.75") center to center
- LFX8: min 1593mm (62.7") , max 1783mm (70.2") center to center

Make sure to use the proper anchors depending on the type of ceiling. The bracket was engineered to optionally be pendant mounted (hardware not included).




Remove the lens and LED tray from back housing.

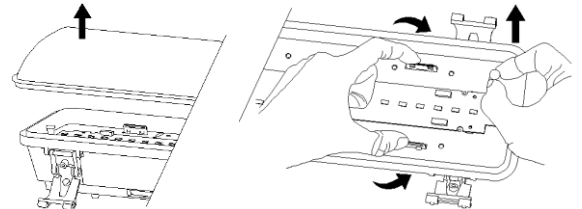


Attach the back housing to the stainless steel hook brackets.

Run AC power source wires into cable gland connector and connect to the light fixture.

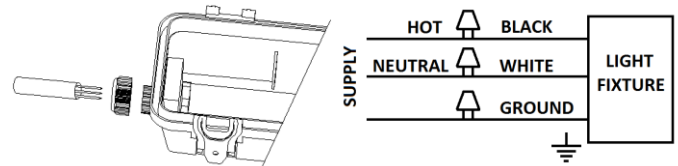

Snap LED tray into back housing and reinstall lens.

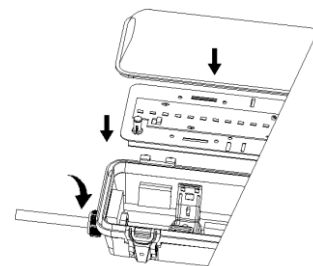

INSTRUCTIONS D'INSTALLATION



RISQUE D'ÉLECTROCUTION

LIRE, COMPRENDRE, et SUIVRE ces instructions avant d'installer l'équipement.

AVERTISSEMENT

Débranchez l'alimentation de l'alimentation électrique au panneau de service (de fusible ou de disjoncteur). Ne pas le faire pourrait entraîner des blessures graves ou la mort. Seul un électricien qualifié doit installer cet appareil et l'installation doit conformer au code électrique canadien Partie I et tous les codes et règlements locaux. S'assurer que seuls les outils, les matériaux et l'équipement approprié est utilisé pour terminer l'installation avant de tenter l'installation.

SÉCURITÉ


- Pour votre sécurité, il est nécessaire d'effectuer une mise à la terre appropriée.
- L'équipement doit être monté dans des endroits où le personnel non autorisé ne sera pas facilement sous réserve de l'altération.
- Ne pas utiliser cet équipement pour autre chose que sa destination.
- Entretien de cet équipement doit être effectuée par un personnel qualifié.
- Conservez ces instructions pour référence future.

INSTALLATION


Fixer les deux crochets en acier inoxydable au plafond en utilisant les vis.

- LFX4: min 768mm (30.25") à max 908mm (35.75") centre à centre
- LFX8: min 1593mm (62.7") à max 1783mm (70.2") centre à centre

Utiliser le dispositif d'ancrage adéquat selon le type de plafond. Le support peut aussi être installé en suspension (quincaillerie nécessaire non fournie).




Enlever la plaque de DEL et le couvercle du boîtier.

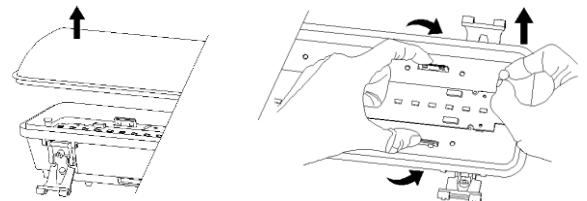

Fixer le boîtier aux deux crochets.

Exécutez source d'alimentation de fils de tension nominale dans le connecteur cordon de serrage fourni. Connecter les fils de tension de la ligne à C.A. aux fils noir et blanc du luminaire.

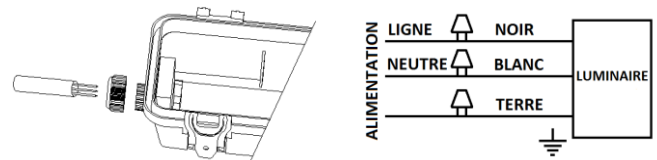

Réinstaller la plaque de DEL et le couvercle sur le boîtier.

